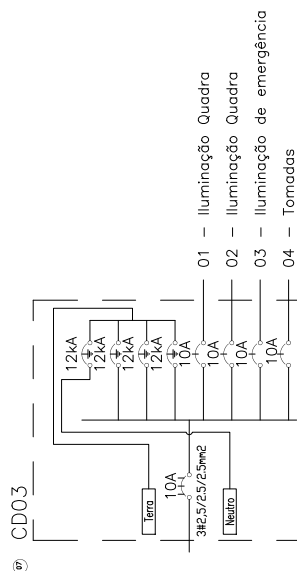
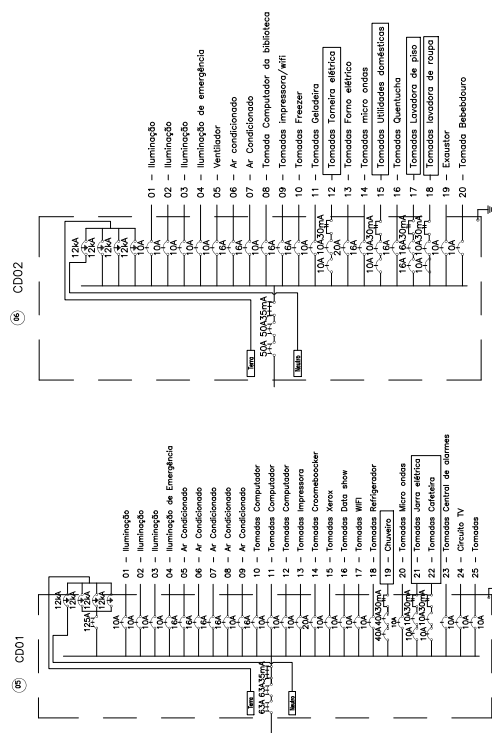


[illegible]

04 QUADRO GERAL

Quatro	Intensidade	Potência (V.A)		Comprimento (m)	Corrente (A)	Perda (A)	Dimensão do		
		Demandado	Realizado				(Cap. Cond.)	(Q. Induct.)	
Q001	3280,0	88%	28934,4	40,00	43,8	39-63,0A	10	16	
	3280,0	82%	26897,6	30,00	40,8	39-50,0A	0	6	
	Q003	2554,0	98%	25029,9	15,00	3,8	39-100A	0,5	0,5
QUADRO GERAL		58,335,0	89%	52112,6	10,00	79,0	39-100A	35	4

[illegible][illegible]